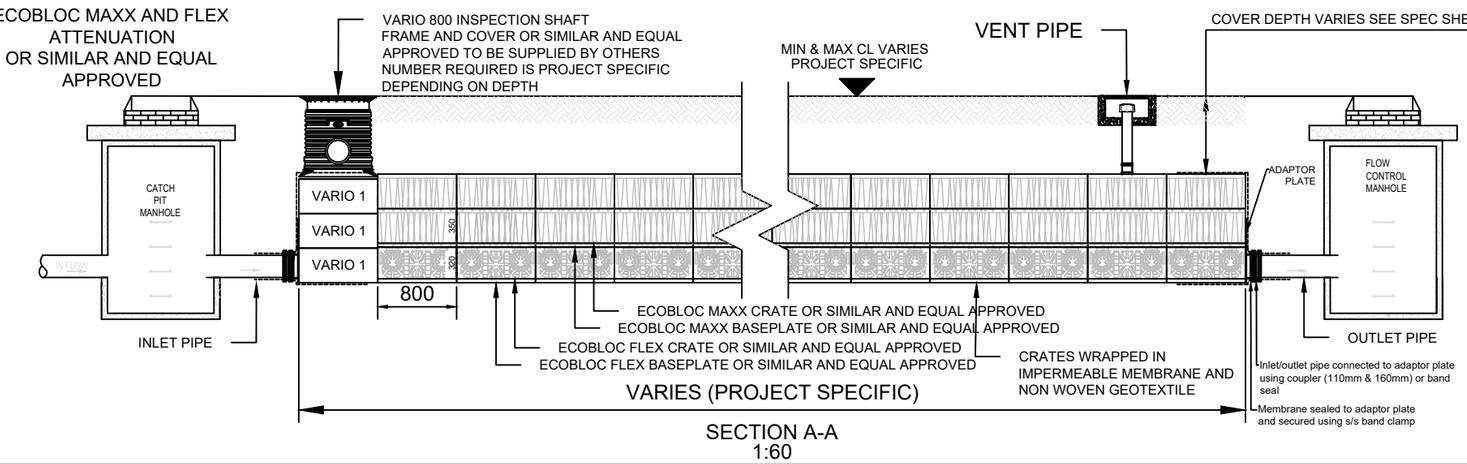

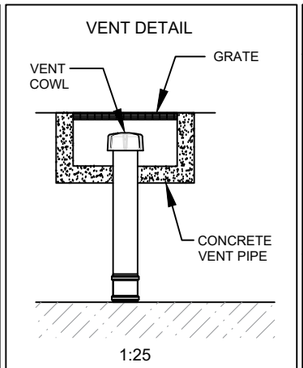

NB. The attenuation tank must be vented to a suitable location above ground and it is recommended to have one Ø110mm vent pipe for every 7,500m² of impermeable catchment area.

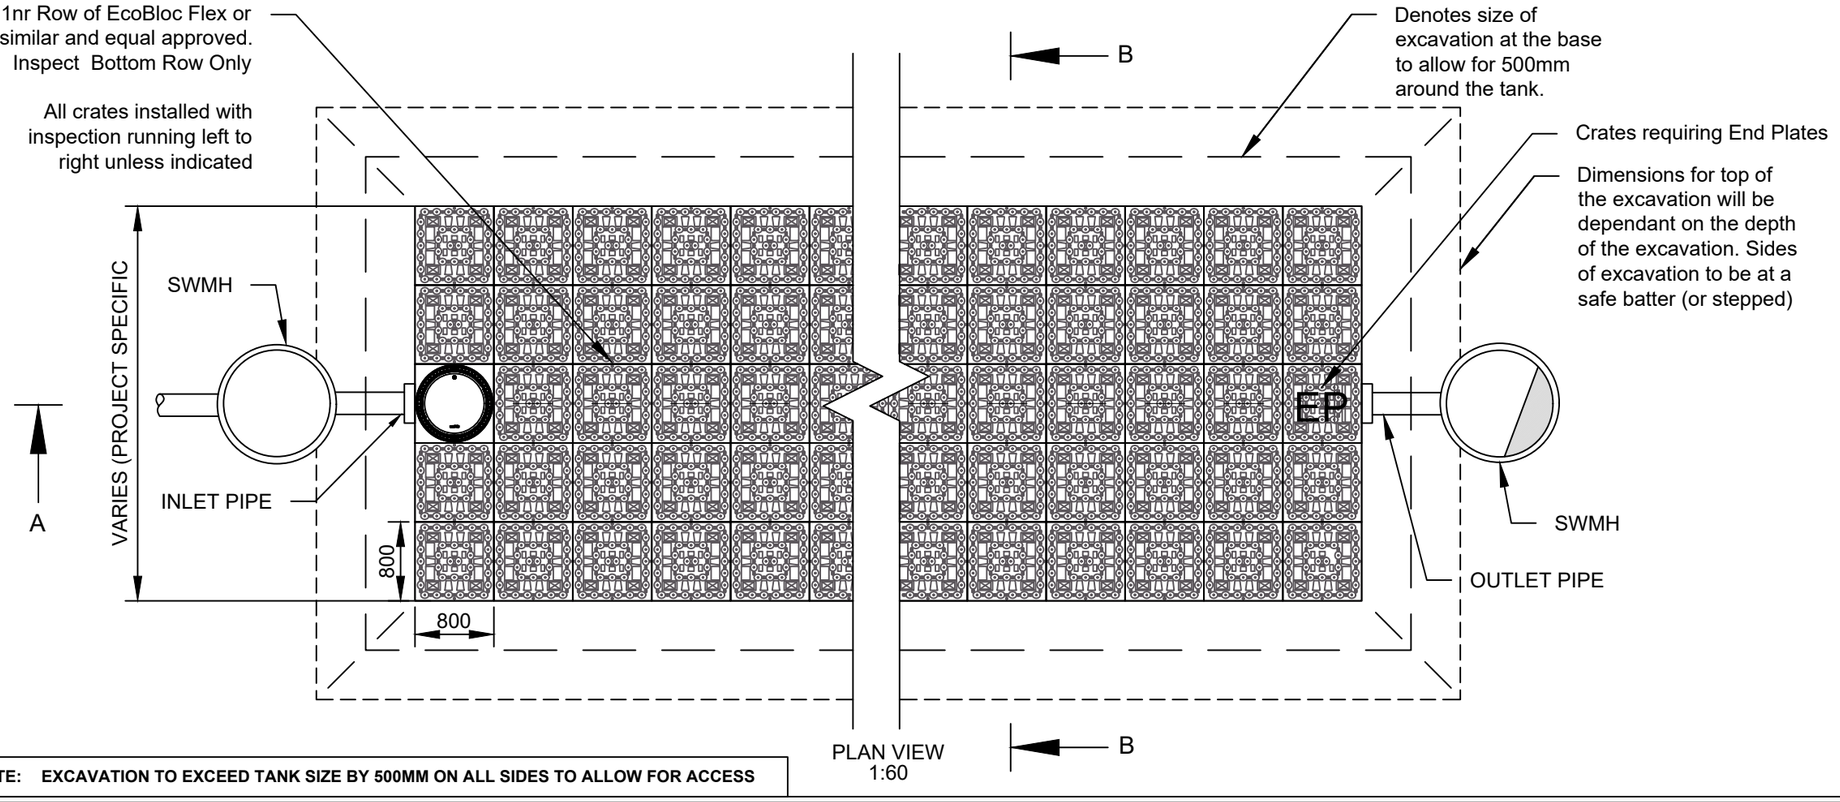

NOTE: EXCAVATION TO EXCEED TANK SIZE BY 500MM ON ALL SIDES TO ALLOW FOR ACCESS

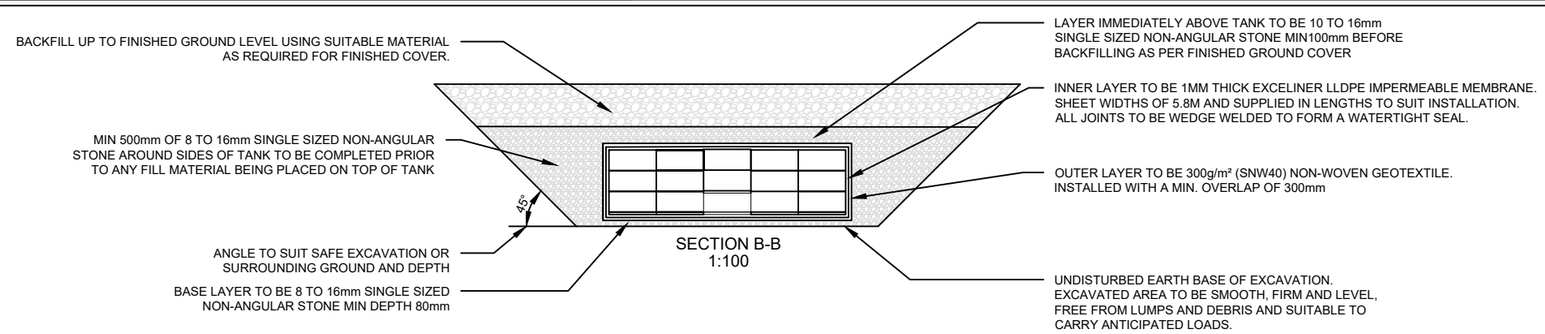

DO NOT SCALE - IF IN DOUBT ASK

NOTES:-

1. All dimensions in mm, unless otherwise stated.
2. All dimensions are nominal and may vary within manufacturing tolerances.
3. All site temporary enabling works by others.
4. Graf products to be installed in strict accordance with Graf recommendations.
5. This drawing is intended for guidance only. Confirmation of the suitability for a particular project should be sought from the consulting engineers prior to final design or commencement of any construction works.

NOTE : THIS PRODUCT MAY BE SUBSTITUTED BY A SIMILAR AND EQUAL PRODUCT TO THE APPROVAL OF THE ENGINEER AND CLIENT

ECOBLOC MAXX (OR SIMILAR AND EQUAL APPROVED)

	Crate	Baseplate
Dimensions (mm)	800 x 800 x 350	800 x 800 x 40
Gross Volume (m3)	0.225m³	0.025m³
Net Volume (m3)	0.217m³	0.020m³
Material	Polypropylene	Polypropylene
Weight	9kg	4kg
Void Ratio	>96% depending on number of layers	
Inspectable	Yes, when combined with EcoBloc Flex	

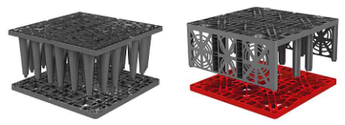

rev.	modifications	by	chkd	date
P.01	Issued for PUBLIC CONSULTATION	KK	EM	09.08.24

file P:\Jod-jobs\6763 LCC Lanesboro\0700 Drawings\0702 Preliminary Design\01 WIP\6763-JOD-ZZ-XX-DR-A-7006.7007.7008.dwg

client Longford County Council

project PROPOSED RESIDENTIAL DEVELOPMENT & ASSOCIATED WORKS AT RADHARC NA MUILEANN, LANESBOROUGH, CO. LONGFORD

stage PUBLIC CONSULTATION

title PROPOSED ATTENUATION TANK DETAIL - SHEET 1 OF 3

scale AS STATED @ A3

surveyed	drawn	checked	date
--	PC	EM	MAR '24

© COPYRIGHT OF

JENNINGS O'DONOVAN & PARTNERS
CONSULTING ENGINEERS,
FINISKLIN,
SLIGO,
IRELAND.
TEL. +353 (0)71 916 1416
FAX. +353 (0)71 916 1080
Email: info@jodireland.com

drawing no. 6763-JOD-ZZ-XX-DR-A-7006

revision P.01